



# SPECIFICATIONS

Model: CDM.5-2x-2f Pneumatic

## DIMENSIONS:

### Extractor

A: Length: 83"

B: Width: 37"

C: Height: 77.5"

D: Frame Height: 68"

### Air Compressor (not shown)

LxWxH – 73.6x33.1x74.8"

### Chiller (not shown)

LxWxH – 31x20x39"

### Air Dryer (not shown)

LxWxH – 40.5x30x63"


## WEIGHT:

Extractor - 1150 lbs.

Air Compressor - 1069 lbs.

Chiller - 340 lbs.

Air Dryer – 500 lbs.

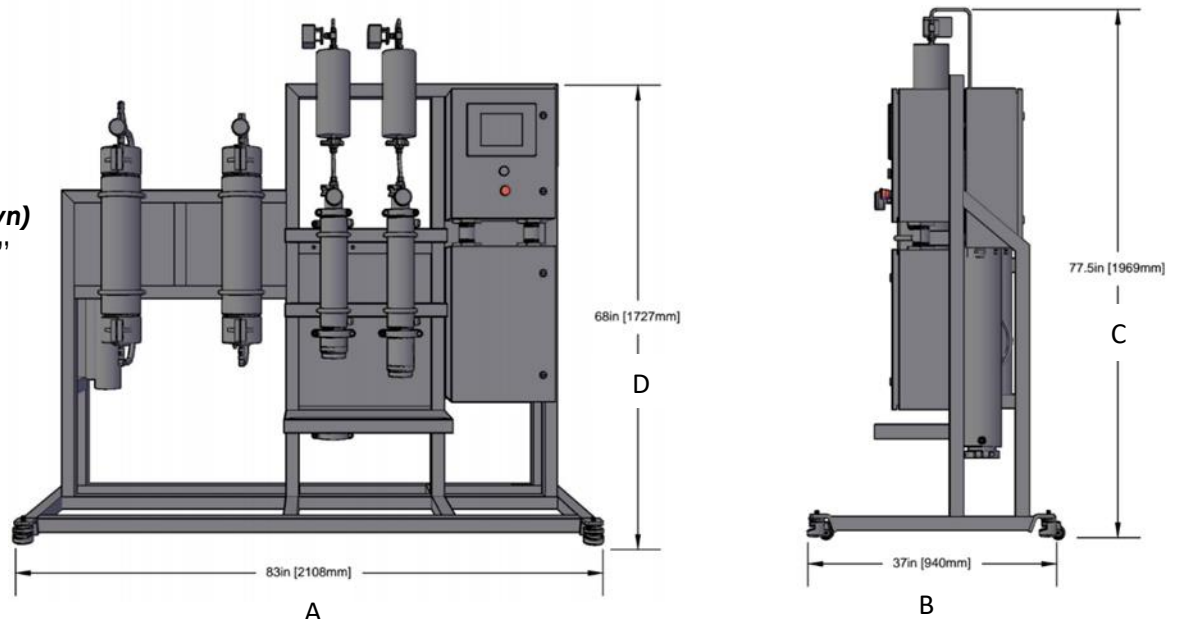

## ELECTRICAL:

**Extractor** - Voltage: 208-240 volt single phase (with neutral) - Current: 23 amps (30A breaker and wire)

**Air Compressor** - Voltage: 230 volt three phase - Current: 77 amps (100A breaker and wire)

**Air Dryer** – Voltage: 115 volt single phase – Current:

**Chiller** - Voltage: 208-230 volt single phase - Current: 26 amps (40A breaker and wire)

## SPACE REQUIRED:

**Extractor:** Minimum operating space is 3 feet around 3 sides

**Compressor:** Minimum operating space is 30 inches around all sides of compressor. Can be remote located up to 200 feet from the extractor with appropriate piping installed.

**Chiller:** Minimum operating space is 20 inches around all sides. Can be remote located up to 20 feet from the extractor.

**Air Dryer:** Installed next to air compressor.

## Certifications:

EPR – “Pressure Safety Inspectors LLC”

ETL – “Intertek Field Inspection”

Facility must meet all state and local regulations. It is recommended to have at least one carbon dioxide detector with signs denoting hazardous carbon dioxide working environment.

For more information please call: 720.541.7301